

Boil Water Notice for Central Washington Water Supply Corporation/TX2390055
4/4/2022

Due to a main line break on Highway 36, which resulted in system pressures falling below 20 psi in the area, the Texas Commission on Environmental Quality has required the Central Washington Water Supply Corporation/TX2390055 public water system to notify all customers in this area to boil their water prior to consumption (e.g., washing hands/face, brushing teeth, drinking, etc). Children, seniors, and persons with weakened immune systems are particularly vulnerable to harmful bacteria, and all customers should follow these directions).

To ensure destruction of all harmful bacteria and other microbes, water for drinking, cooking, and ice making should be boiled and cooled prior to use for drinking water or human consumption purposes. The water should be brought to a vigorous rolling boil and then boiled for two minutes.

In lieu of boiling, individuals may purchase bottled water or obtain water from some other suitable source for drinking water or human consumption purposes.

When it is no longer necessary to boil the water, the public water system officials will notify customers that the water is safe for drinking water or human consumption purposes.

Once the boil water notice is no longer in effect, the public water system will issue a notice to customers that rescinds the boil water notice in a manner similar to this notice.


Please share this information with all the other people who drink this water in this area, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this notice in a public place or distributing copies by hand or mail.

If you have questions concerning this matter, you may contact Matthew Monfreda at 737-228-2841.

****THIS BOIL WATER NOTICE IS ONLY FOR THE AFFECTED AREA AS NOTED ON THE MAP AND WHICH LOST WATER SERVICE ON THE EVENING OF 4/4/2022.****

A highway construction crew boke a 4" water main and we finalized the repairs and restored water service. A bacteriological sample is currently being delivered to the lab today, 4/5/2022 and the boil water notice will be rescinded if the sample results return free of coliform when returned no earlier than 24 hours from being tested.


CWCWSC GIS Map

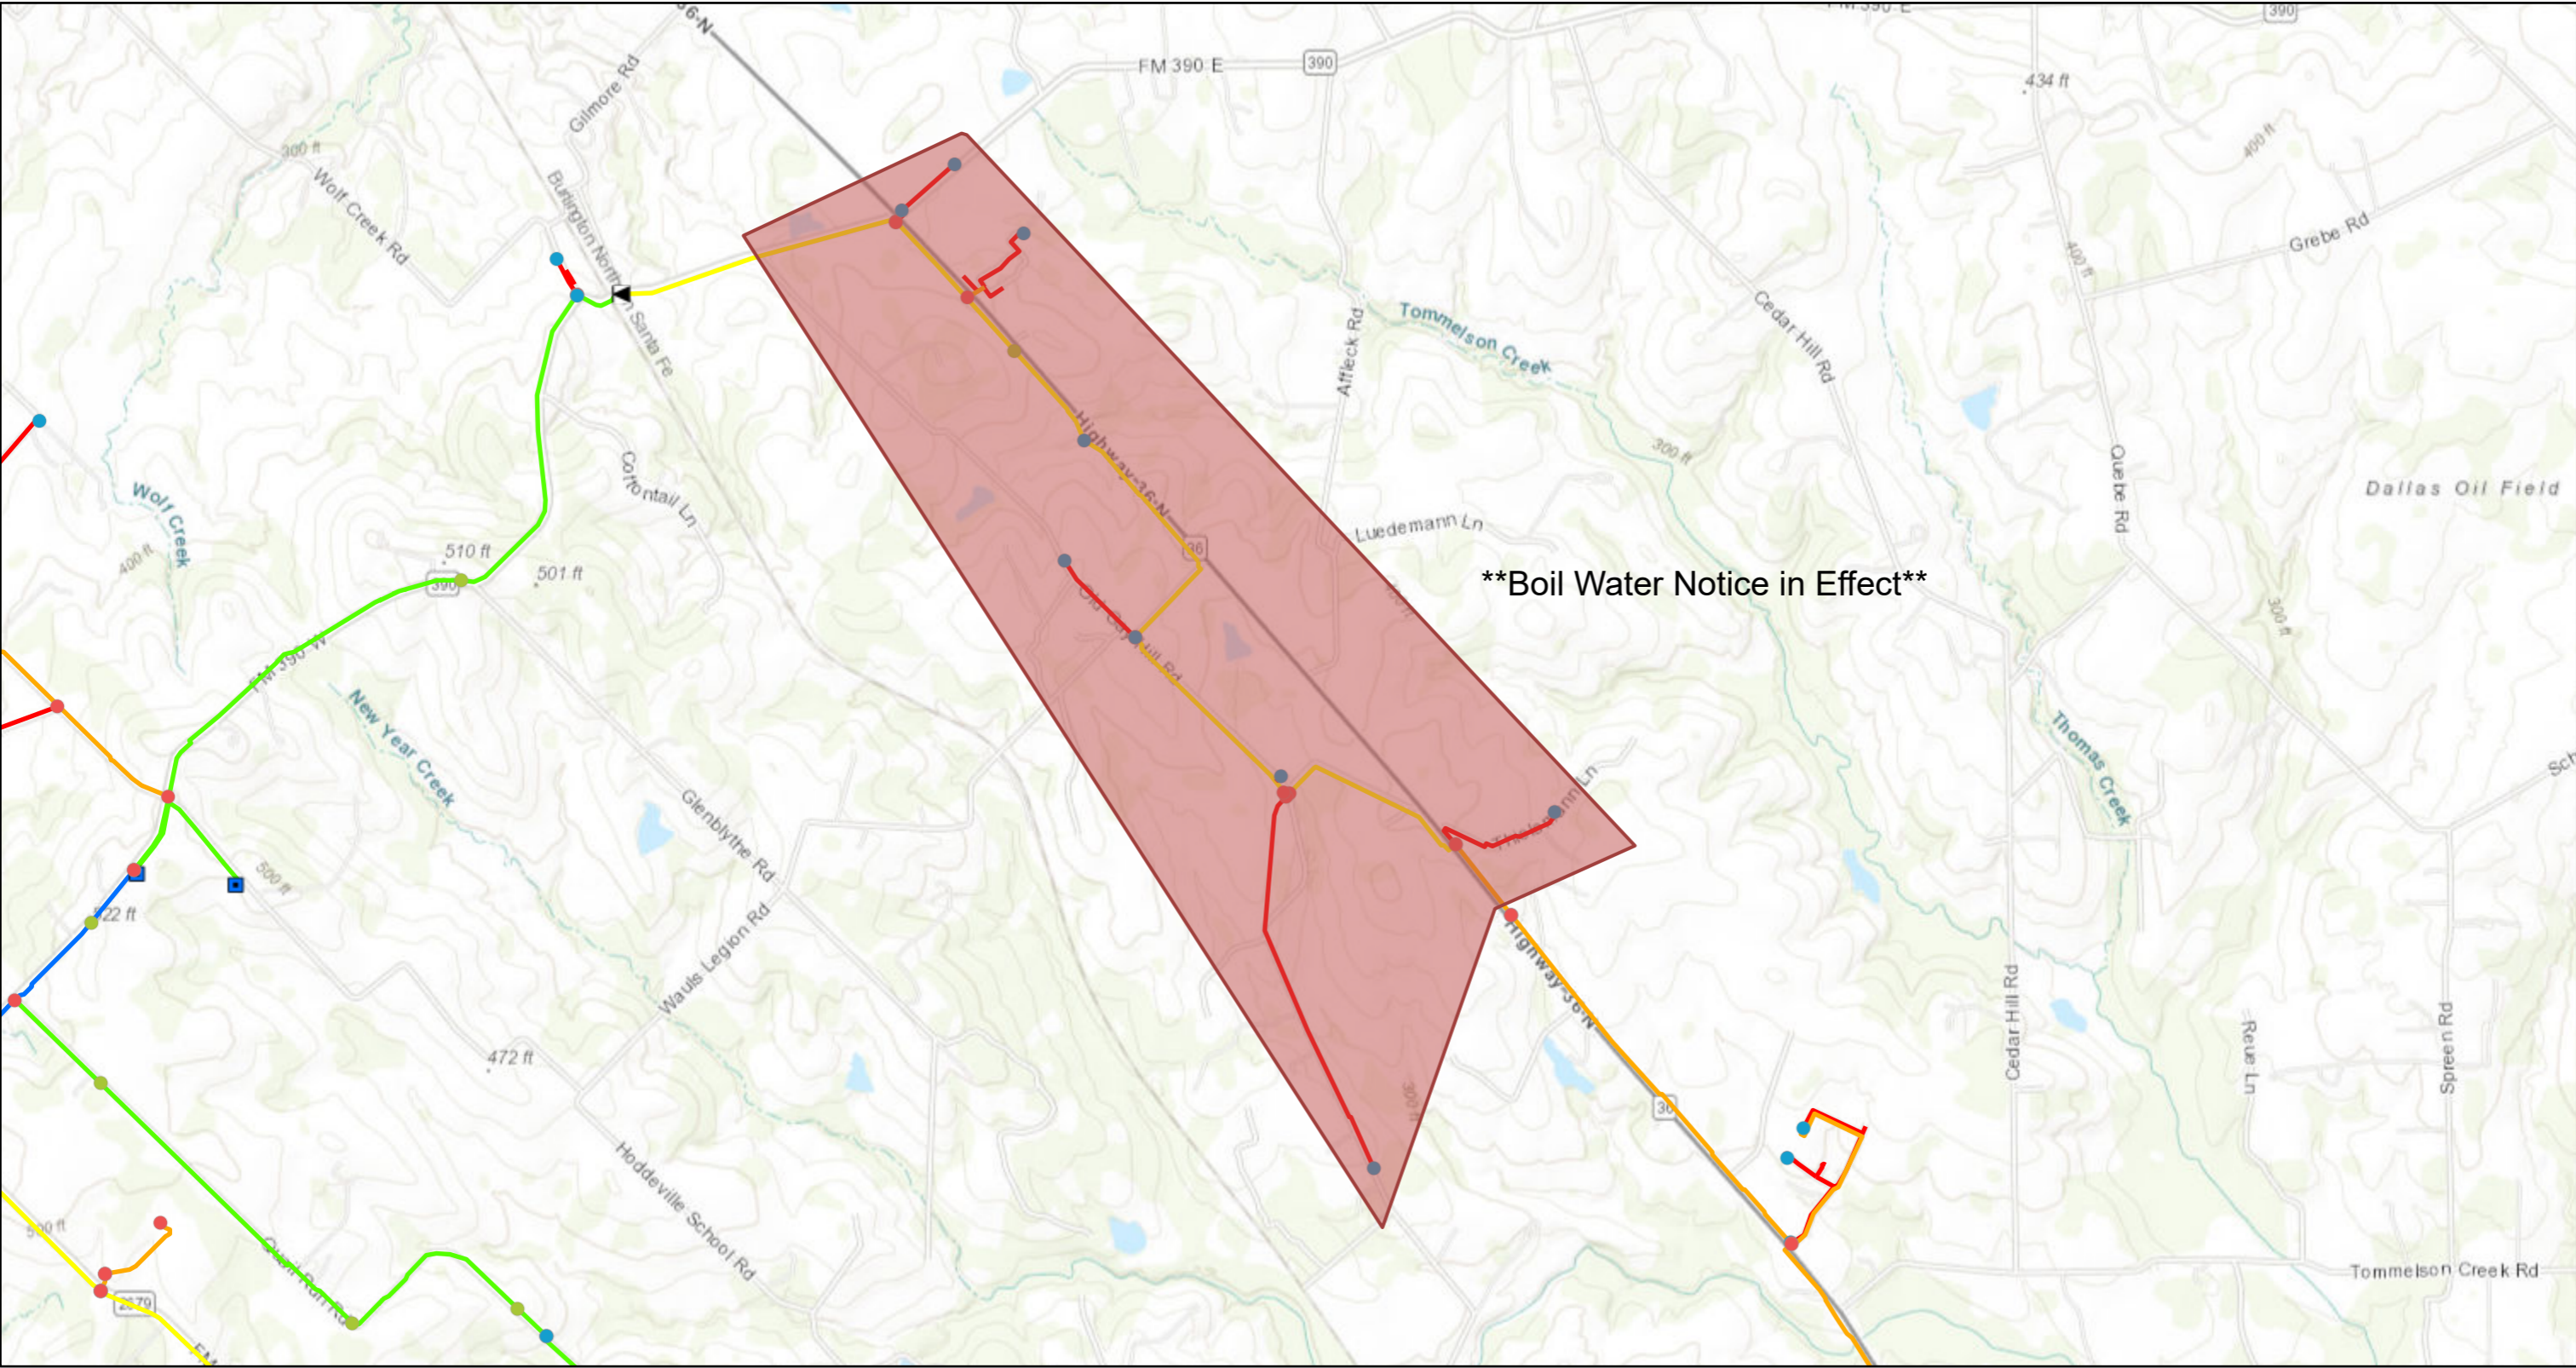

4/5/2022, 11:31:05 AM

1:36,112

- | | | | | |
|---------|--------|------------|------|------|
| Valve | ● ARV | ◀ Reducer | — 3" | — 8" |
| ● Gate | ● PRV | Water Main | — 4" | |
| ● Flush | ■ Well | — 2" | — 6" | |



Sources: Esri, HERE, Garmin, Intermap, increment P Corp., GEBCO, USGS, FAO, NPS, NRCAN, GeoBase, IGN, Kadaster NL, Ordnance Survey, Esri Japan, METI, Esri China (Hong Kong), (c) OpenStreetMap contributors, and the GIS User Community